

Overlook Tank

200,000 Gallon Concrete Tank
Pad 477.35'
2010

Upper Tank

150,000 Gallon Redwood Tank
Pad 477.35'
1965


Well Site Source

(206 psi to Upper Tank; 106 psi to Lower Tank (assuming 17' water table))

2002 Well
Elevation 40'
PS 2100508-003

2008 Well
Elevation 37'
PS 2100508-004

- Pipe Abbreviations**
- AC Asbestos Cement Pipe, Class 200
 - C-900 AWWA C-900 PVC Pipe
 - CICL Cast Iron Cement Lined (labeled on plans), but actually Ductile Iron Cement Lined Pipe, Class 22
 - DICL Ductile Iron Cement Lined Pipe
 - HDPE High Density Polyethylene Pipe
 - PVC Poly Vinyl Chloride Pipe
 - Stainless Welded Stainless Steel Pipe
 - WSCL Welded Steel Cement Lined Pipe

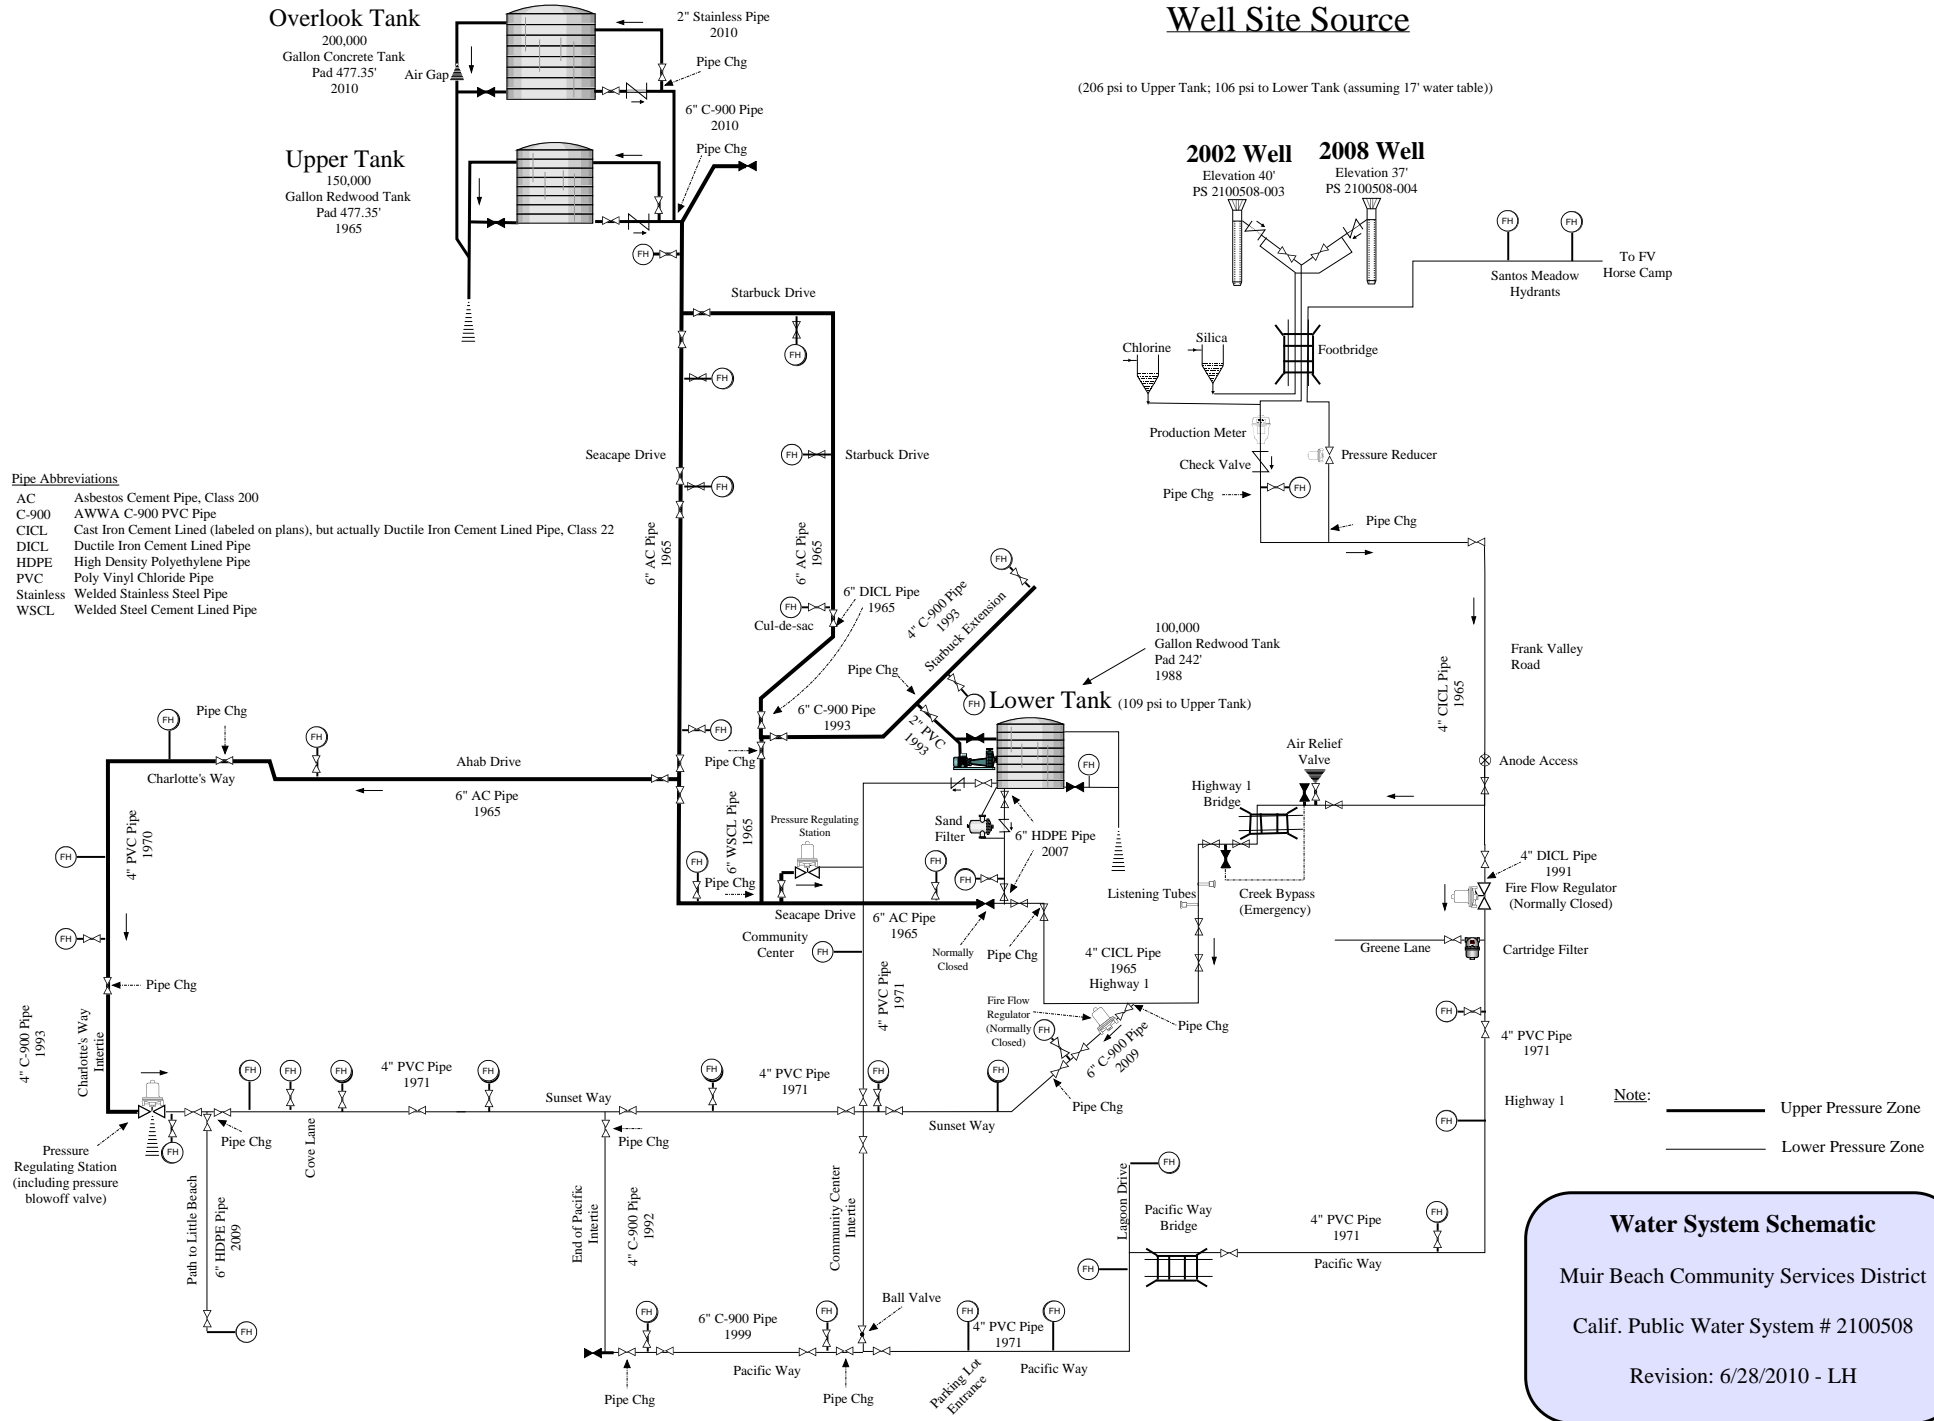

Water System Schematic

Muir Beach Community Services District

Calif. Public Water System # 2100508

Revision: 6/28/2010 - LH