

Overlook Tank

200,000
Gallon Concrete Tank
Pad 477.35'
2010

Well Site Source

(206 psi to Upper Tank; 106 psi to Lower Tank (assuming 17' water table))

2002 Well


Elevation 40'
PS 2100508-003

2008 Well

Elevation 37'
PS 2100508-004

Pipe Abbreviations

- AC Asbestos Cement Pipe, Class 200
- C-900 AWWA C-900 PVC Pipe
- CICL Cast Iron Cement Lined (labeled on plans), but actually Ductile Iron Cement Lined Pipe, Class 22
- DICL Ductile Iron Cement Lined Pipe
- HDPE High Density Polyethylene Pipe
- PVC Poly Vinyl Chloride Pipe
- Stainless Welded Stainless Steel Pipe
- WSCL Welded Steel Cement Lined Pipe

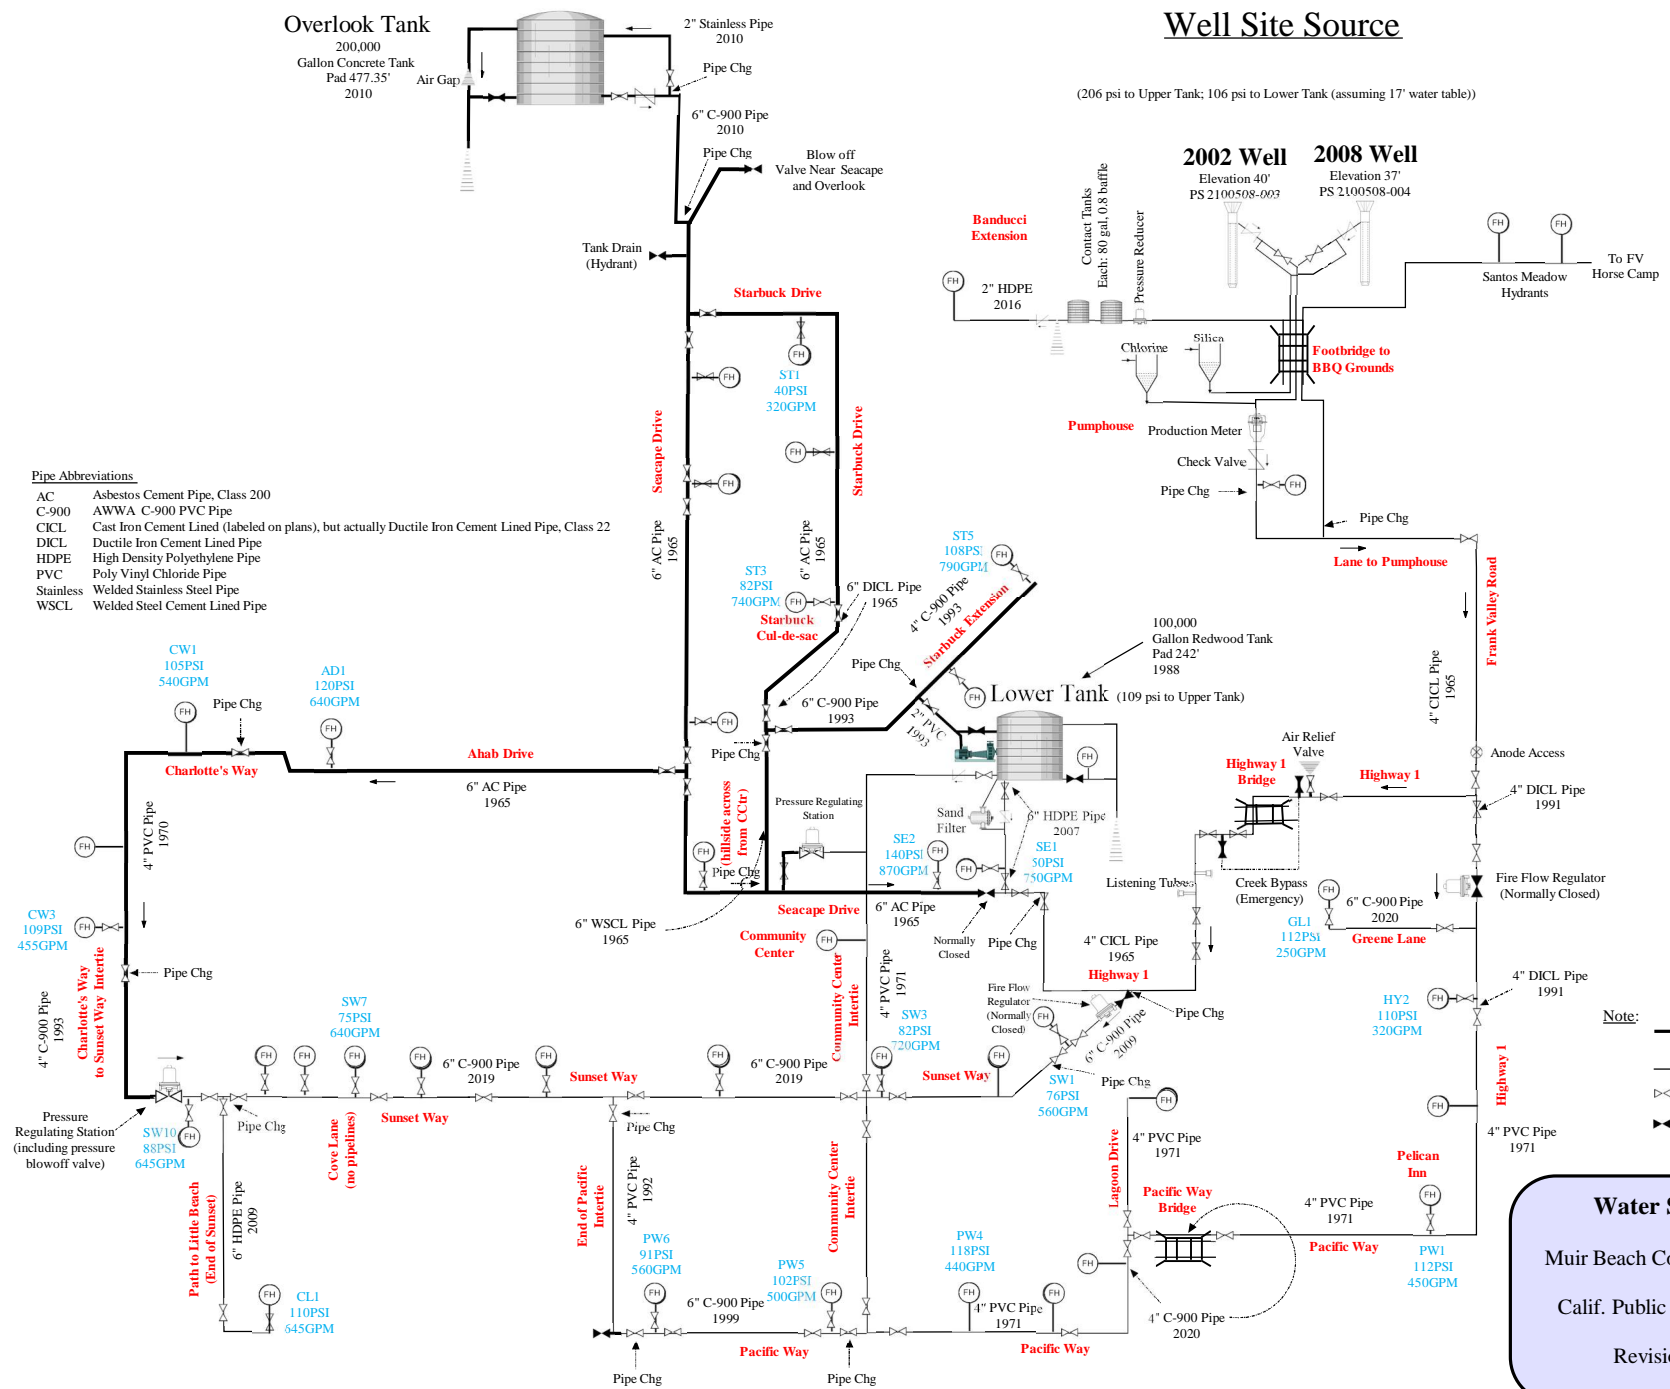

- Note:**
- Upper Pressure Zone
 - Lower Pressure Zone
 - ⊗ Denotes normally open valve
 - ⊠ Denotes normally closed valve

Water System Schematic

Muir Beach Community Services District
Calif. Public Water System # 2100508
Revision: 1/13/2021 - LH